



1 HDPE TO CMP PRE-ASSEMBLY
140 SCALE: NTS

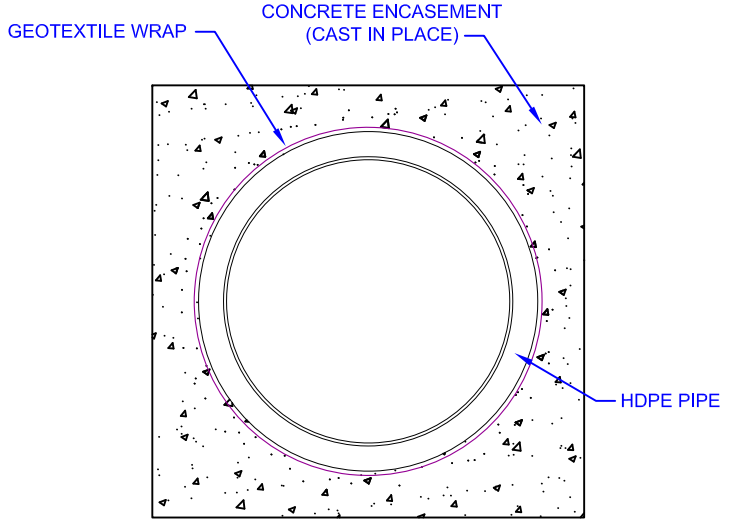

3 CONCRETE ENCASEMENT SECTION DETAIL
140 SCALE: NTS

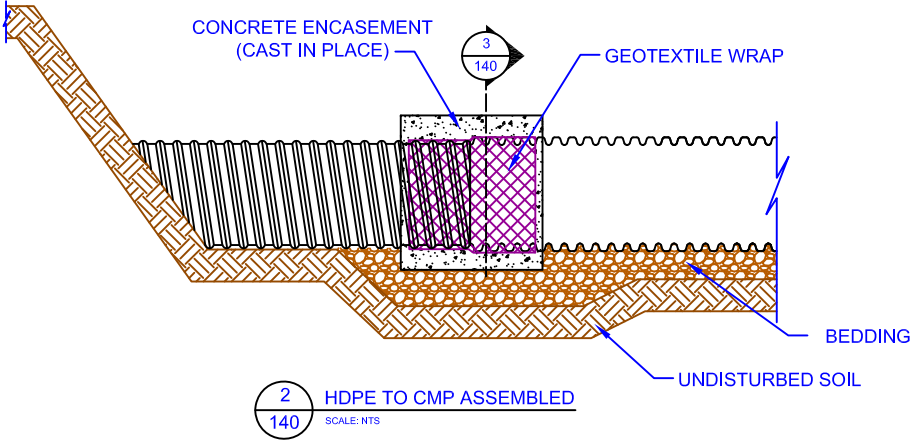

2 HDPE TO CMP ASSEMBLED
140 SCALE: NTS

NOTES:

- ALL PIPE SHALL BE INSTALLED IN ACCORDANCE WITH ASTM D2321 - STANDARD PRACTICE FOR UNDERGROUND INSTALLATION OF FLEXIBLE THERMOPLASTIC SEWER PIPE, LATEST EDITION.

THIS DETAIL DEPICTS RECOMMENDED INSTALLATION PRACTICES AND IS NOT INTENDED TO SUPERSEDE ANY NATIONAL, STATE OR LOCAL SPECIFICATIONS. PRINSCO BEARS NO RESPONSIBILITY FOR ANY ALTERATIONS, REVISION AND/OR DEVIATION FROM THIS STANDARD DETAIL. PRINSCO HAS NOT PERFORMED ANY ENGINEERING OR DESIGN SERVICE FOR THIS PROJECT. THE DESIGN ENGINEER SHALL REVIEW THESE DETAILS PRIOR TO CONSTRUCTION TO VERIFY SUITABILITY. © PRINSCO, INC.



1717 16TH ST. NE
WILLMAR, MN 56201
www.prinSCO.com

TITLE: HDPE PIPE - DISSIMILAR CONNECTION - HDPE TO CMP CONCRETE ENCASED WITHOUT ADAPTER			REV: B
DRAWN BY: TRA	DATE: 03-Jul-17	DRAWING NUMBER: D-1-140	
SCALE: NTS	SHEET: 1 OF 1		