



1 HDPE TO RCP PRE ASSEMBLY
124 SCALE: NTS

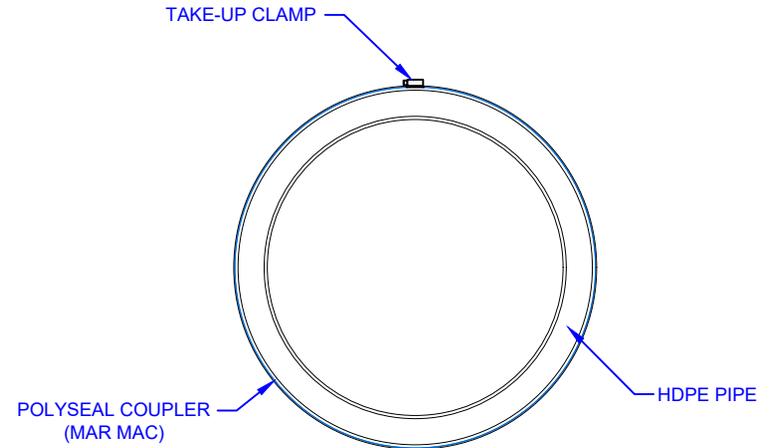

3 POLYSEAL COUPLER SECTION DETAIL
124 SCALE: NTS

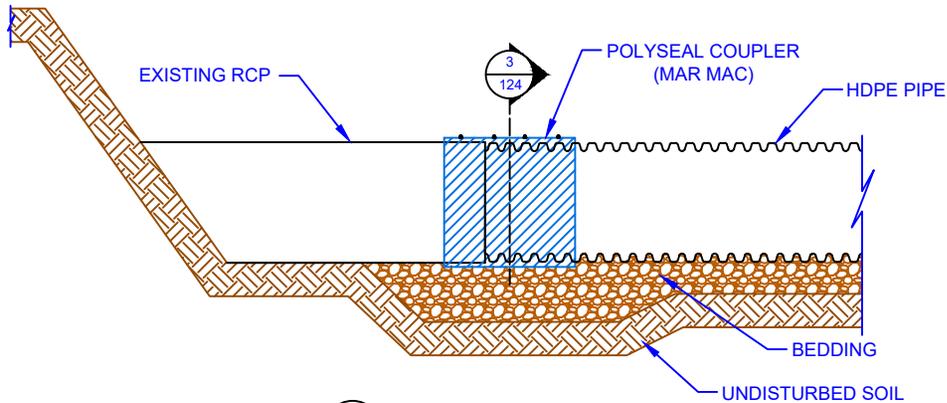

2 HDPE TO RCP ASSEMBLED
124 SCALE: NTS

NOTES:

- ALL PIPE SHALL BE INSTALLED IN ACCORDANCE WITH ASTM D2321 - STANDARD PRACTICE FOR UNDERGROUND INSTALLATION OF FLEXIBLE THERMOPLASTIC SEWER PIPE, LATEST EDITION.
- POLYSEAL IS A REGISTERED TRADEMARK OF MAR MAC PRODUCTS INC. (WWW.MARMAC.COM).
- RCP DIMENSIONS SHOULD BE CHECKED TO ENSURE SIMILAR OD OF HDPE.

THIS DETAIL DEPICTS RECOMMENDED INSTALLATION PRACTICES AND IS NOT INTENDED TO SUPERSEDE ANY NATIONAL, STATE OR LOCAL SPECIFICATIONS. PRINSCO BEARS NO RESPONSIBILITY FOR ANY ALTERATIONS, REVISION AND/OR DEVIATION FROM THIS STANDARD DETAIL. PRINSCO HAS NOT PERFORMED ANY ENGINEERING OR DESIGN SERVICE FOR THIS PROJECT. THE DESIGN ENGINEER SHALL REVIEW THESE DETAILS PRIOR TO CONSTRUCTION TO VERIFY SUITABILITY. © PRINSCO, INC.



1717 16TH ST. NE
WILLMAR, MN 56201
www.prinSCO.com

TITLE: HDPE PIPE - DISSIMILAR CONNECTION - HDPE TO RCP MARMAC			
DRAWN BY: RMA	DATE: 31-Aug-22	DRAWING NUMBER:	
SCALE: NTS	SHEET: 1 OF 1	D-1-124	