
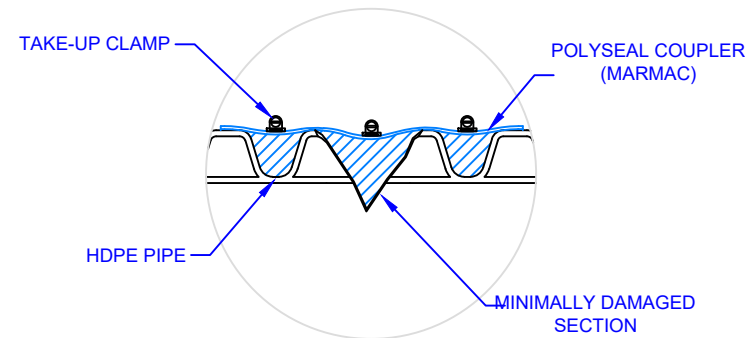


A POLYSEAL DETAIL
136 SCALE: NTS

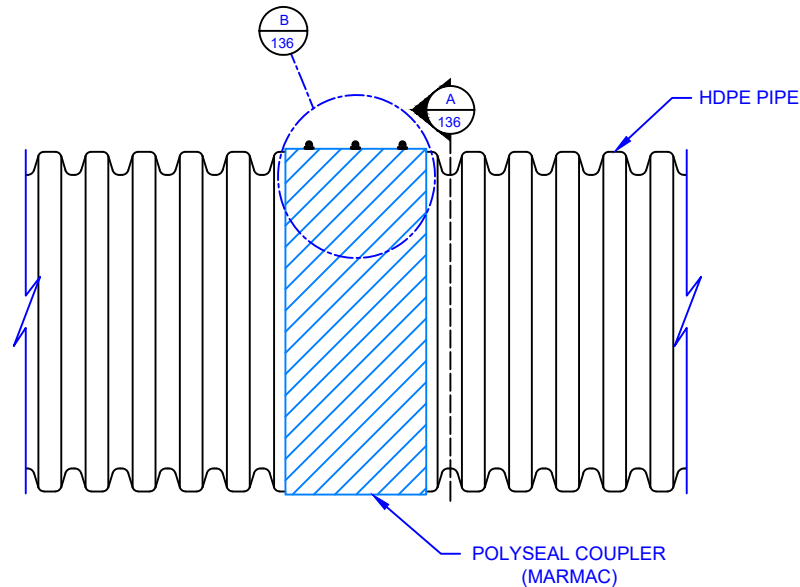

B POLYSEAL SECTION DETAIL
136 SCALE: NTS

NOTES:

- ALL PIPE SHALL BE INSTALLED IN ACCORDANCE WITH ASTM D2321 - STANDARD PRACTICE FOR UNDERGROUND INSTALLATION OF FLEXIBLE THERMOPLASTIC SEWER PIPE, LATEST EDITION.
- SEE MARMAC INC., FOR SPECIFIC PRODUCT INFORMATION AND SELECTION.
- FOR USE ON 4" - 60" PIPE.
- POLYSEAL IS A REGISTERED TRADEMARK OF MARMAC PRODUCTS INC. (WWW.MARMAC.COM)

APPLICATION NOTES:

- MARMAC POLYSEAL MASTIC BANDING CAN BE USED TO WRAP A SMALL DAMAGED SECTION OF PIPE (SHOWN ABOVE) OR CAN CONNECT TWO LENGTHS OF PIPE AFTER REMOVING THE DAMAGED SECTION.
- STEEL STRAPS ARE TIGHTENED AROUND THE PIPE TO PROVIDE A POSITIVE SEAL.
- FLOWABLE FILL AROUND COUPLER IS OPTIONAL AND NOT REQUIRED.
- REFER TO MANUFACTURER'S INSTALLATION RECOMMENDATIONS FOR FURTHER DETAIL.

THIS DETAIL DEPICTS RECOMMENDED INSTALLATION PRACTICES AND IS NOT INTENDED TO SUPERSEDE ANY NATIONAL, STATE OR LOCAL SPECIFICATIONS. PRINSCO BEARS NO RESPONSIBILITY FOR ANY ALTERATIONS, REVISION AND/OR DEVIATION FROM THIS STANDARD DETAIL. PRINSCO HAS NOT PERFORMED ANY ENGINEERING OR DESIGN SERVICE FOR THIS PROJECT. THE DESIGN ENGINEER SHALL REVIEW THESE DETAILS PRIOR TO CONSTRUCTION TO VERIFY SUITABILITY. © PRINSCO, INC.



1717 16TH ST. NE
WILLMAR, MN 56201
www.prinSCO.com

TITLE: HDPE PIPE - PIPE REPAIR - MARMAC		
DRAWN BY: AED	DATE: 01-Aug-22	DRAWING NUMBER:
SCALE: NTS	SHEET: 1 OF 1	D-1-136